


SECTION

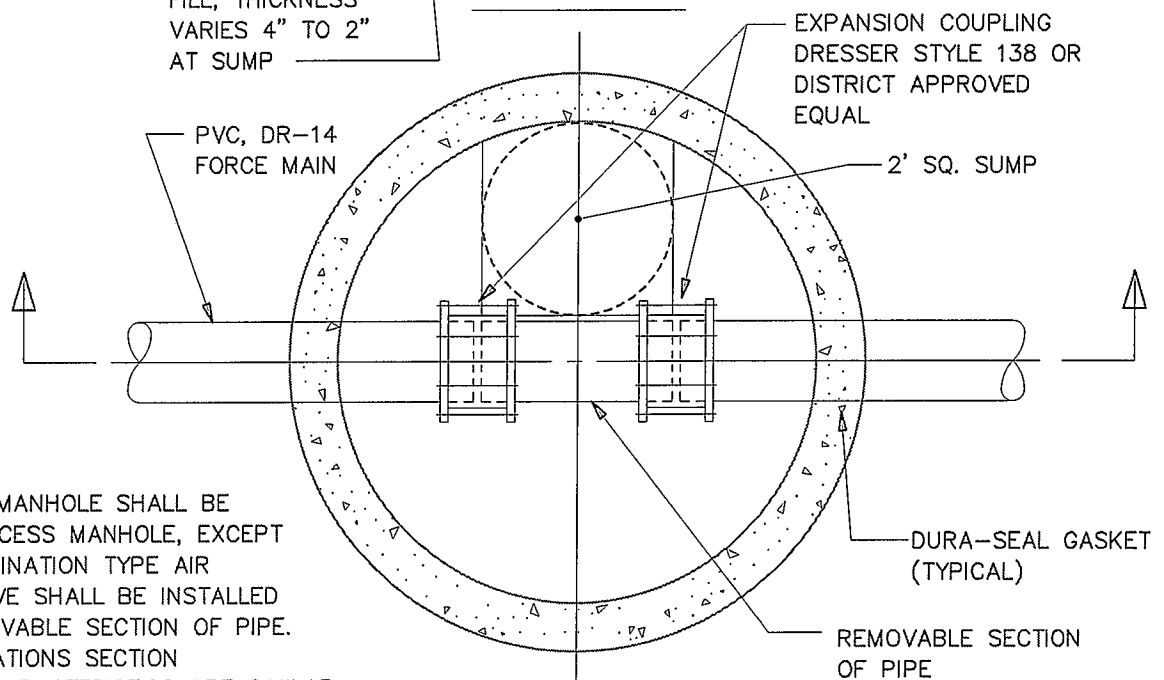

PLAN

NOTES:

1. SUMMIT TYPE MANHOLE SHALL BE EQUAL TO ACCESS MANHOLE, EXCEPT THAT A COMBINATION TYPE AIR RELEASE VALVE SHALL BE INSTALLED ON THE REMOVABLE SECTION OF PIPE. SEE SPECIFICATIONS SECTION
2. ALL OTHER CHARACTERISTICS ARE SIMILAR TO STANDARD MANHOLE AS SHOWN ON CCSD STANDARD DRAWING S1.1.

NO SCALE



CLERMONT COUNTY
SEWER DISTRICT

APPROVED _____
DATE _____

STANDARD FORCE
MAIN ACCESS
MANHOLE

DRAWING NO.

S5.2.1